13 July 2026

Trading conduct report 5-11 July 2026

Market monitoring weekly report

Trading conduct report 5-11 July 2026

1. Overview

1.1. This week the average spot price decreased from $67/MWh to $66/MWh. Prices have remained low due to high levels of hydro storage. National controlled storage is currently 86% nominally full and is 130% of the historical average for this time of year.

2. Spot prices

2.1. This report monitors underlying wholesale price drivers to assess whether trading periods require further analysis to identify potential non-compliance with the trading conduct rule. In addition to general monitoring, it also singles out unusually high-priced individual trading periods for further analysis by identifying when wholesale electricity spot prices are outliers compared to historic prices for the same time of year.

2.2. Between 5-11 July:

(i) The average spot price for the week was $66/MWh, a decrease of around $1/MWh compared to the previous week.

(ii) 95% of prices fell between $0.64/MWh and $146/MWh.

(iii) Prices have mostly remained low due to high levels of hydro storage.

2.3. On Saturday evening from 6.30pm to 7.30pm the spot price spiked above $200/MWh. The highest prices occurred at 6.30pm when the spot price reached $702/MWh at Benmore and $770/MWh at Ōtāhuhu. At this time, demand was 92MW above forecast and Ōhau's 690MW outage was extended (around 5.15pm, the 6.30pm end time was extended to 8.30pm, and then again to 9.30pm). Stratford peaker 1 was the marginal generator at the time.

2.4. Figure 1 shows the wholesale spot prices at Benmore and Ōtāhuhu alongside the national historic median and historic 10-90th percentiles adjusted for inflation. Prices greater than quartile 3 (75th percentile) plus 1.5 times the inter-quartile range of historic prices, plus the difference between this week's median and the historic median, are highlighted with a vertical black line. Other notable prices are typically marked with black dashed lines, but there were none this week.

Figure 1: Wholesale spot prices at Benmore and Ōtāhuhu, 5-11 July

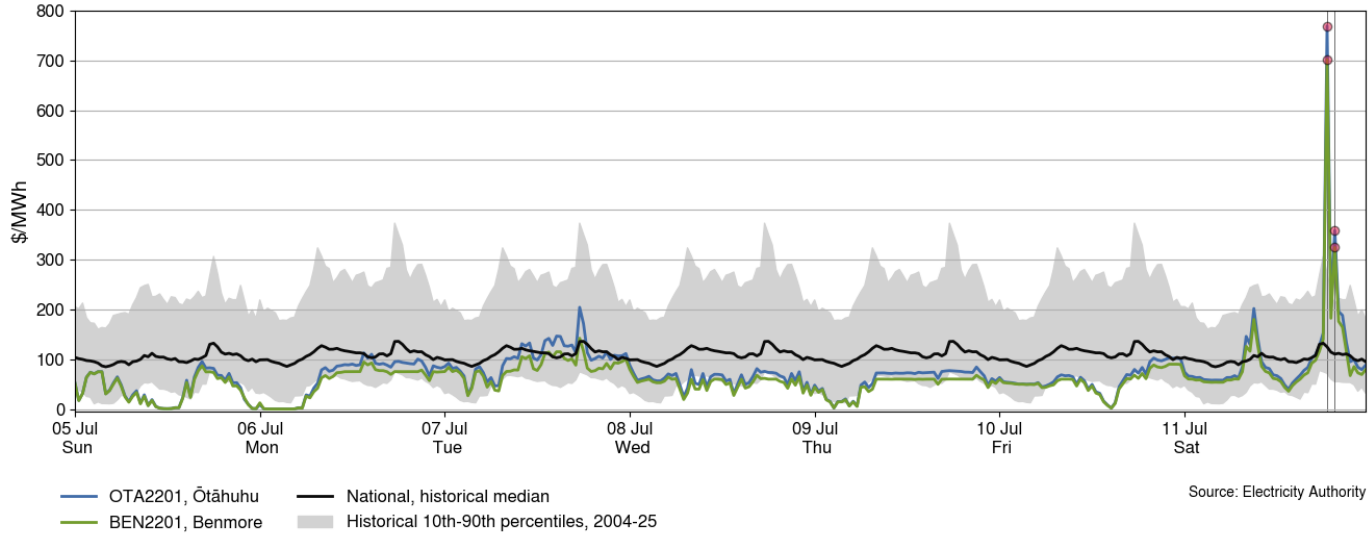

2.5. Figure 2 shows a box plot with the distribution of spot prices during this week and the previous nine weeks. The yellow line shows each week's median price, while the blue box shows the lower and upper quartiles (where 50% of prices fell). The 'whiskers' extend to points that lie within 1.5 times of the interquartile range (IQR) of the lower and upper quartile. Observations that fall outside this range are displayed independently.

2.6. The distribution of spot prices this week was narrower than last week, with more high price outliers. The median price was $63/MWh and most prices (middle 50%) fell between $46/MWh and $80/MWh.

Figure 2: Box plot showing the distribution of spot prices this week and the previous nine weeks

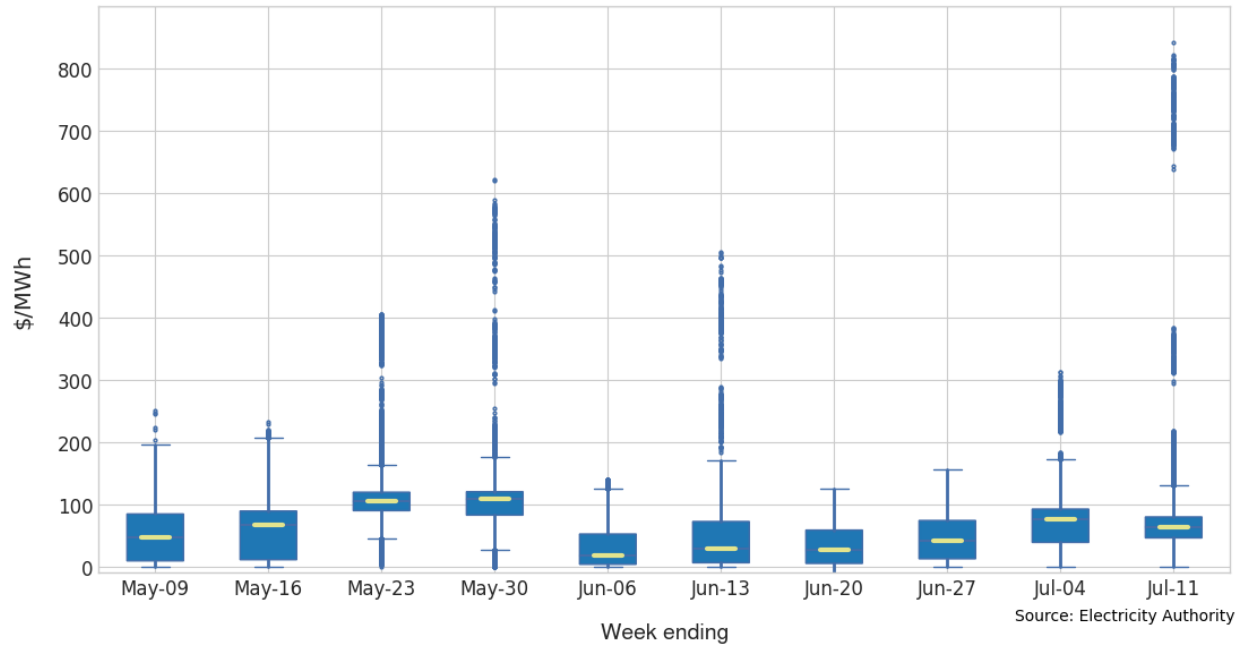

3. Reserve prices

3.1. Fast instantaneous reserve (FIR) prices for the North and South Islands are shown below in Figure 3. FIR prices remained low this week.

Figure 3: Fast instantaneous reserve price by trading period and island, 5-11 July

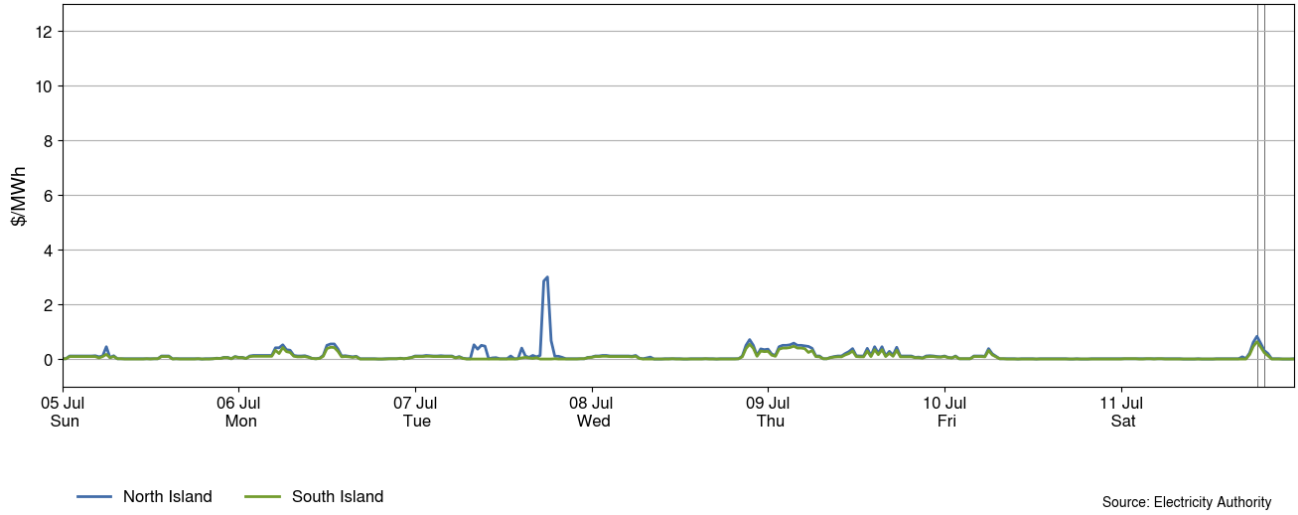

3.2. Sustained instantaneous reserve (SIR) prices for the North and South Islands are shown in Figure 4. SIR prices remained low this week.

Figure 4: Sustained instantaneous reserve by trading period and island, 5-11 July

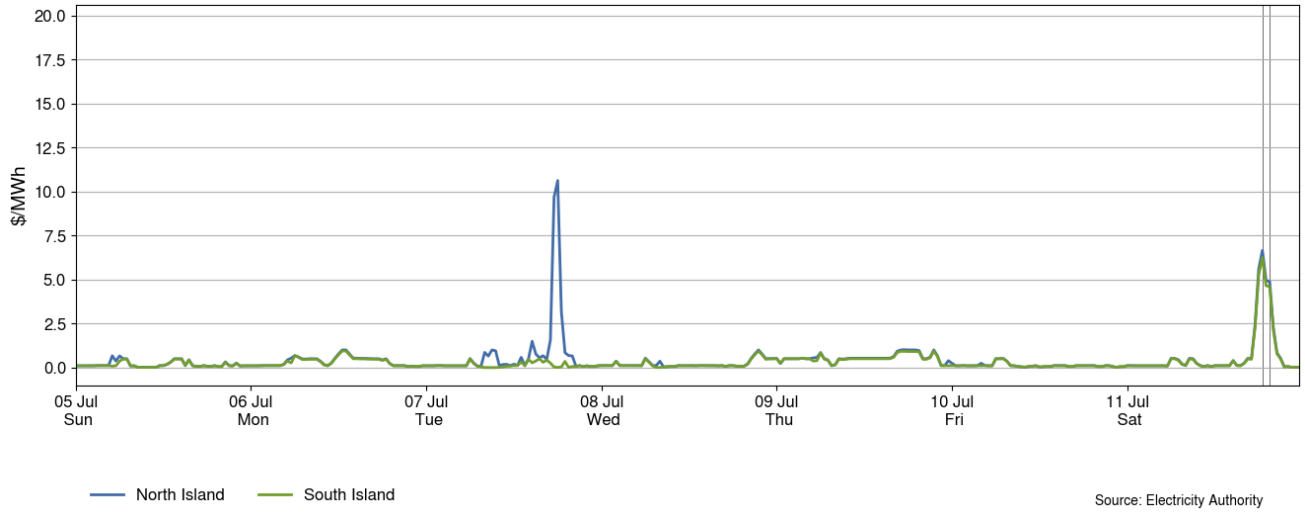

4. Regression residuals

4.1. The Authority's monitoring team uses a regression model to model electricity spot prices. The residuals show how close predicted spot prices were to actual prices. Large residuals may indicate that prices do not reflect underlying supply and demand conditions. Details on the regression model and residuals can be found in Appendix A.

4.2. Figure 5 shows the residuals of autoregressive moving average (ARMA) errors from the daily model. Positive residuals indicate that the modelled daily price is lower than the actual average daily price and vice versa. When residuals are small this indicates that average

daily prices are likely largely aligned with market conditions. These small deviations reflect market variations that may not be controlled in the regression analysis.

4.3. This week, there were no residuals above or below two standard deviations, indicating that prices were similar to those predicted by the model.

Figure 5: Residual plot of estimated daily average spot prices, 1 January 2024 - 11 July 2026

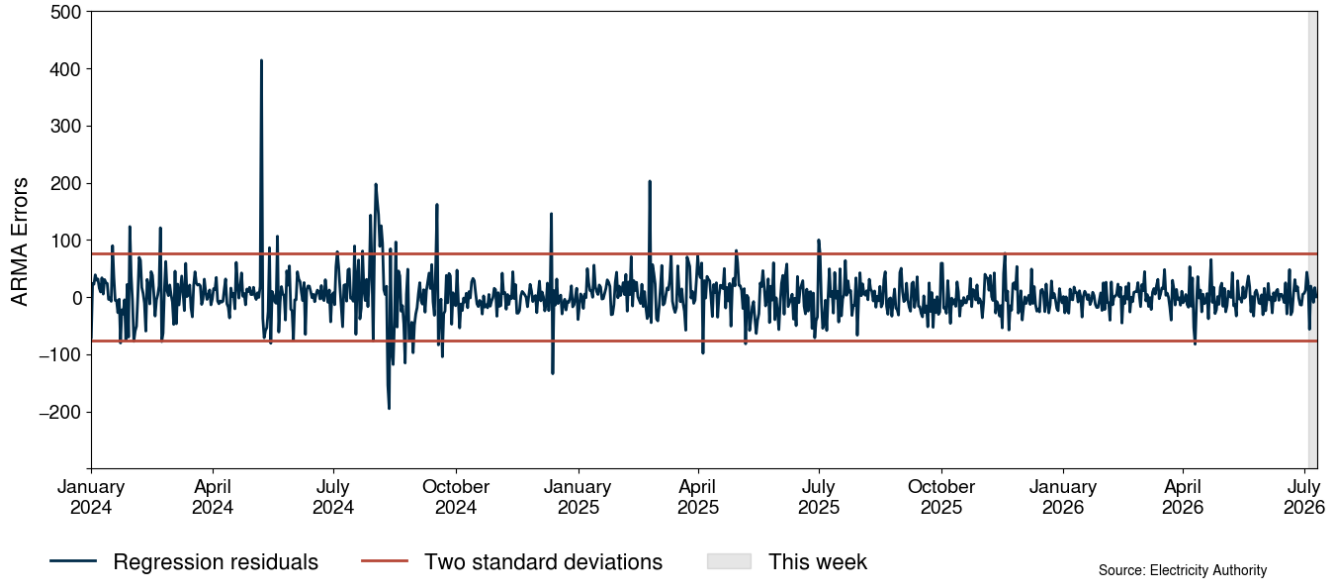

5. HVDC

5.1. Figure 6 shows the HVDC flow between 5-11 July. HVDC flows were mainly northward this week, with some southward flow occurring overnight.

5.2. The highest northward flow of 887MW occurred on Tuesday at 9.00am.

5.3. The highest southward flow of 202MW occurred on Friday at 3.30am.

Figure 6: HVDC flow and capacity, 5-11 July

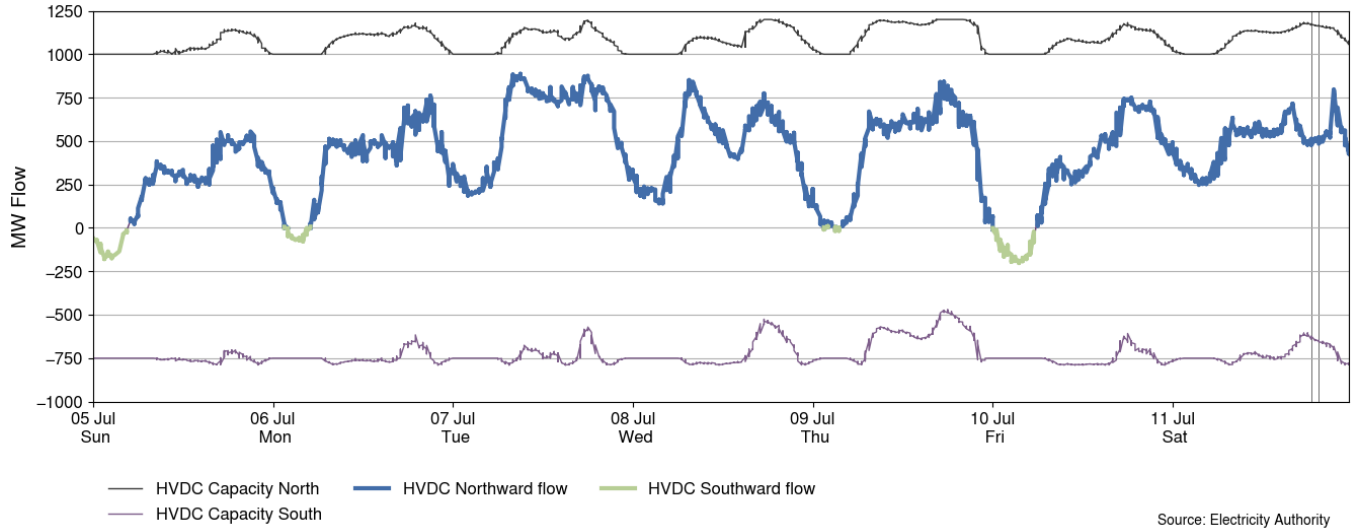

6. Demand

6.1. Figure 7 shows national demand between 5-11 July, compared to the historic range and the demand of the previous week. From Sunday to Thursday, peak demand was generally lower than or similar to last week, while midday demand was generally higher than last week. Demand was lower than last week on Friday due to the Matariki public holiday.

Figure 7: National demand, 5-11 July compared to the previous week

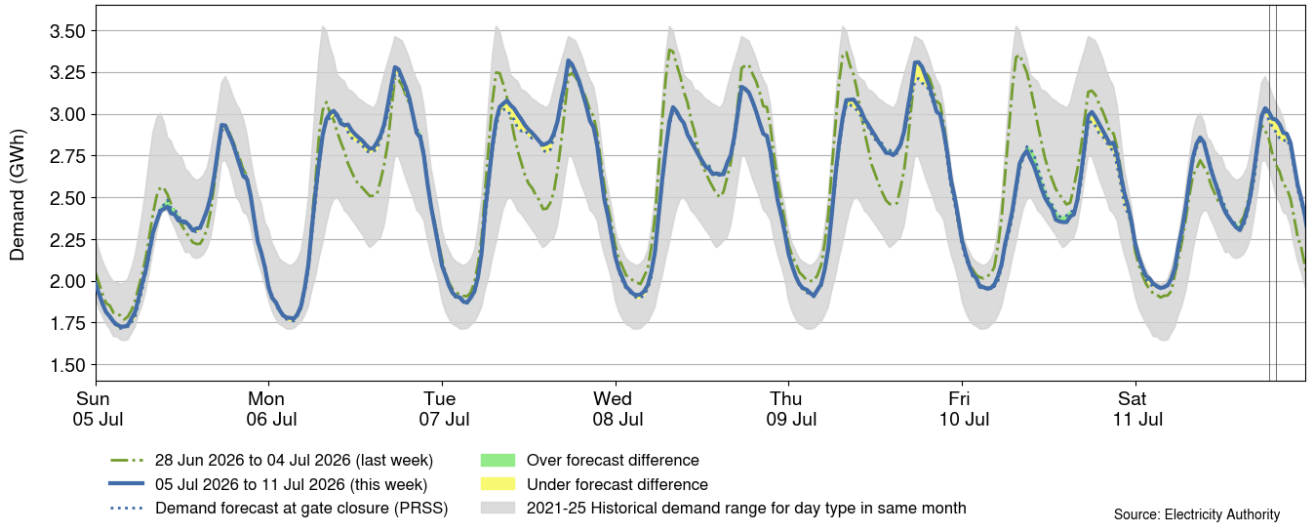

6.2. Figure 8 shows the hourly apparent temperature at main population centres from 5-11 July. The apparent temperature is an adjustment of the recorded temperature that accounts for factors like wind speed and humidity to estimate how cold it feels. Also included for reference is the mean temperature of the main population centres, and the mean historical apparent temperature of similar weeks, from previous years, averaged across the three main population centres.

6.3. Apparent temperatures ranged from 2°C to 15°C in Auckland, -3°C to 10°C in Wellington, and -5°C to 10°C in Christchurch.

Figure 8: Temperatures across main centres, 5-11 July

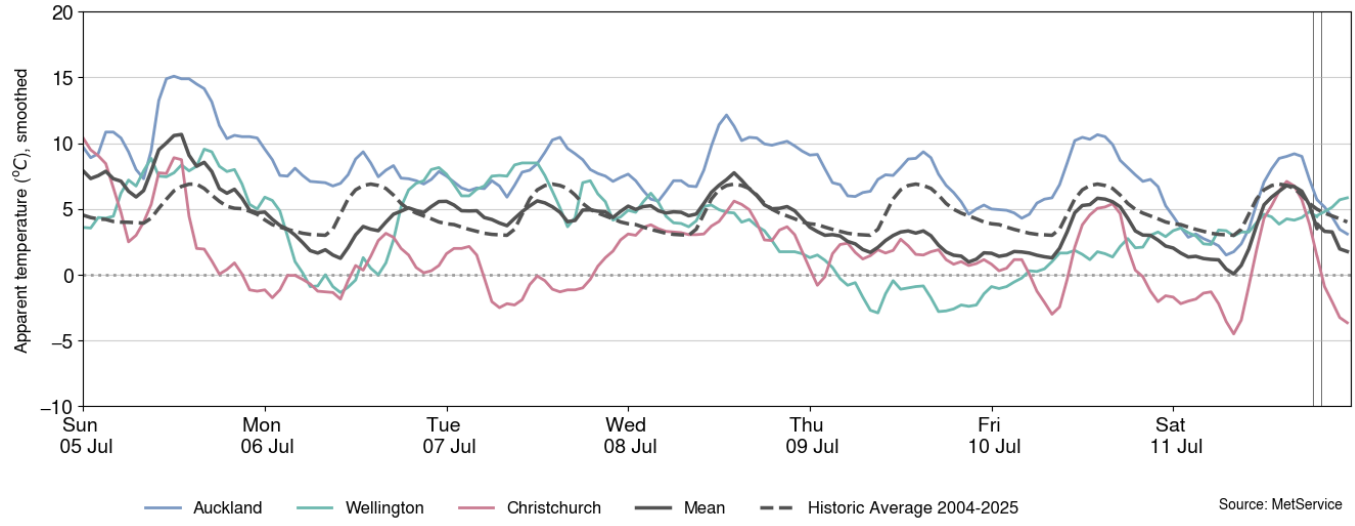

7. Generation

7.1. Figure 9 shows wind generation and forecast from 5-11 July. This week wind generation varied between 55MW and 831MW, with a weekly average of 436MW. Wind generation was relatively high on Monday and Thursday, and relatively low on Saturday.

7.2. Forecasting errors on Sunday afternoon and Tuesday resulted from an amalgamation of forecasting errors at various wind farms.

7.3. Forecasting errors on Friday afternoon resulted from forecasting errors at Waipipi wind farm.

Figure 9: Wind generation and forecast, 5-11 July

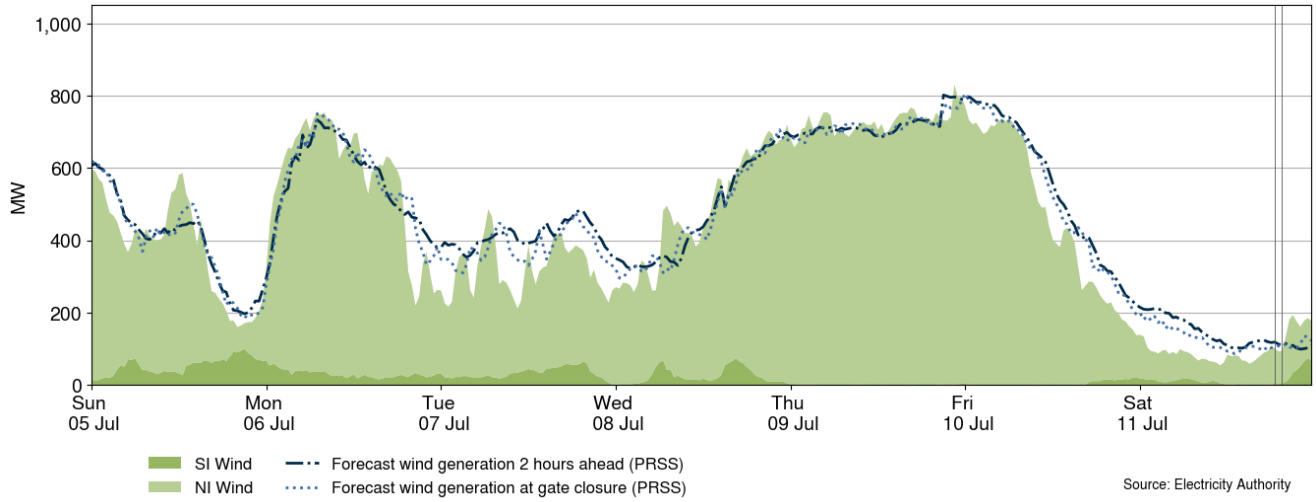

7.4. Figure 10 shows grid connected solar generation from 5-11 July. Solar generation was higher on Wednesday, Friday, and Saturday, and lower for the rest of the week.

7.5. Solar generation peaked at 182MW on Saturday at 1.00pm.

Figure 10: Grid connected solar generation, 5-11 July

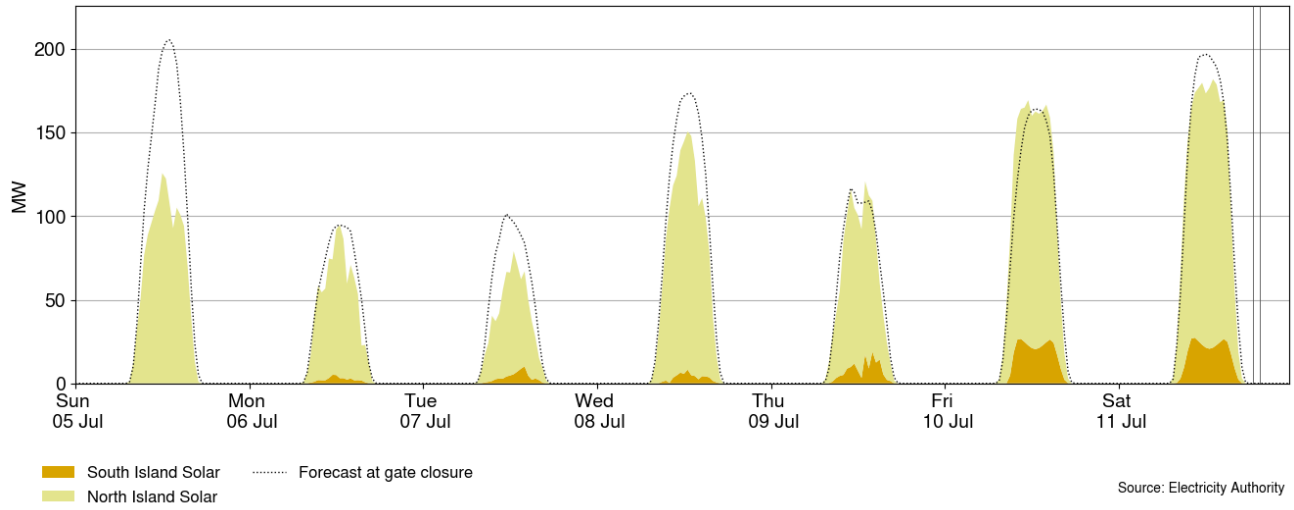

7.6. Figure 11 shows when the grid scale batteries Rotohiko (35MW/35MWh), Ruakākā (100MW/200MWh) and Glenbrook (100MW/200MWh) charged (negative values) and discharged (positive values). Typically, a grid scale battery charges when prices are low and discharges energy back into the grid when prices are higher.

7.7. This week, the batteries have generally charged overnight, when prices are lower, and discharged during the morning and evening peaks, when prices are higher. The batteries have also charged during the day, when solar generation was high.

7.8. Glenbrook was on outage until Thursday.

7.9. On Saturday evening, the batteries began discharging at 5.00pm, so likely did not have much capacity remaining to discharge during the price spike at 6.30pm.

Figure 11: Grid scale battery charge and discharge, 5-11 July

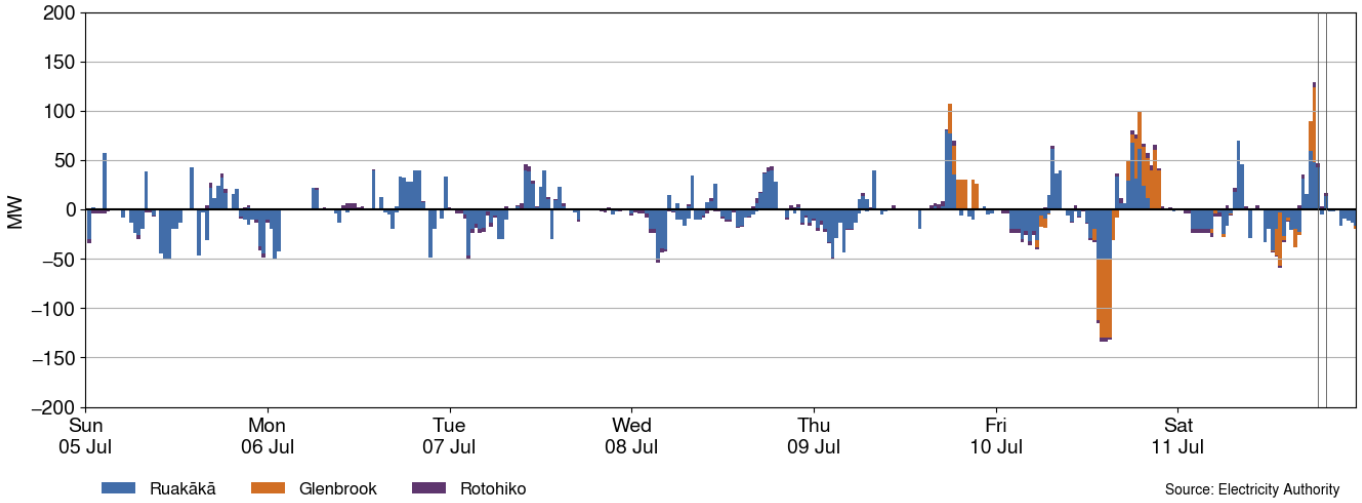

7.10. Figure 12 shows the difference between the national real-time dispatch (RTD) marginal price and a simulated marginal price where the real-time intermittent generation and demand matched the 1-hour ahead forecast (PRSS[1]) projections. The figure highlights when forecasting inaccuracies are causing large differences to final prices. When the difference is positive this means that the 1-hour ahead forecasting inaccuracies resulted in the spot price being higher than anticipated - usually here demand is under forecast and/or intermittent generation is over forecast. When the difference is negative, the opposite is true. Because of the nature of demand and intermittent generation forecasting, the 1-hour ahead and the RTD intermittent generation and demand forecasts will rarely be the same. Trading periods where this difference is exceptionally large can signal that forecasting inaccuracies had a large impact on the final price for that trading period.

7.11. There were some marginal price differences over $50/MWh, most notable during the price spike on Saturday, where the marginal price difference reached $1,060/MWh when demand was 92MW higher than forecast.

7.12. The largest negative difference of $62/MWh occurred on Monday at 12.00am. At this time, wind generation was 43MW above forecast, and demand was 21MW below forecast.

[1] Price responsive schedule short – short schedules are produced every 30 minutes and produce forecasts for the next 4 hours.

Figure 12: Difference between national marginal RTD price and simulated RTD price, with the difference due to one-hour ahead intermittent generation and demand forecast inaccuracies, 5-11 July

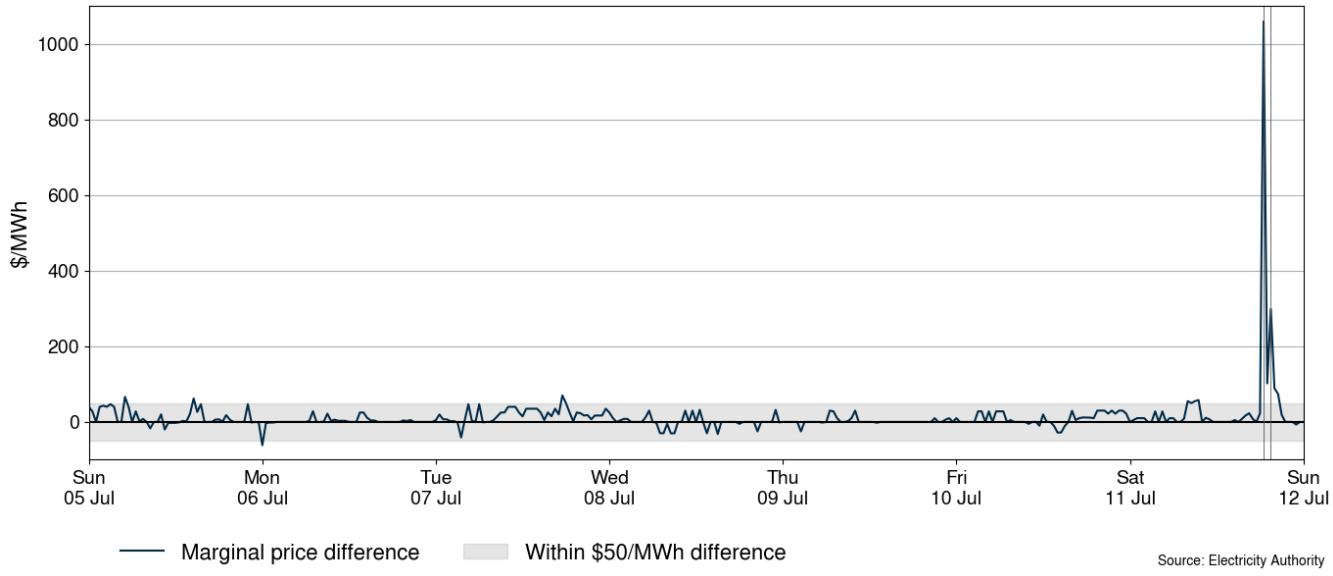

7.13. Figure 13 shows the generation of thermal baseload between 5-11 July. Huntly 1 ran during the day from Sunday to Friday, and Huntly 4 ran on Saturday.

Figure 13: Thermal baseload generation, 5-11 July

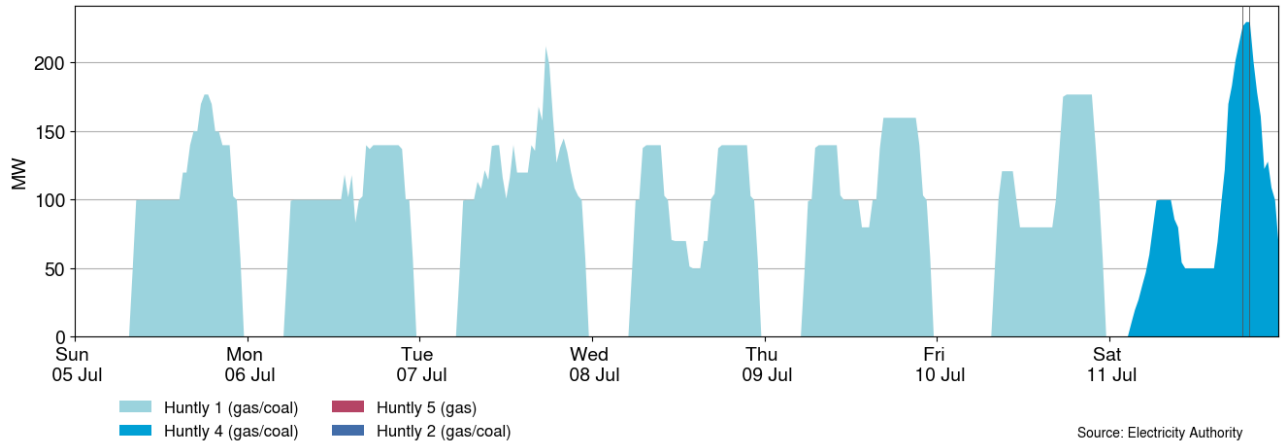

7.14. Figure 14 shows the generation of thermal peaker plants between 5-11 July. Junction road ran at times every day this week, while McKee ran at times on Sunday, Tuesday, and Saturday. Huntly 6 ran at times from Sunday to Tuesday, and on Saturday. The Stratford Peakers ran at times from Monday to Wednesday and briefly on Saturday.

Figure 14: Thermal peaker generation, 5-11 July

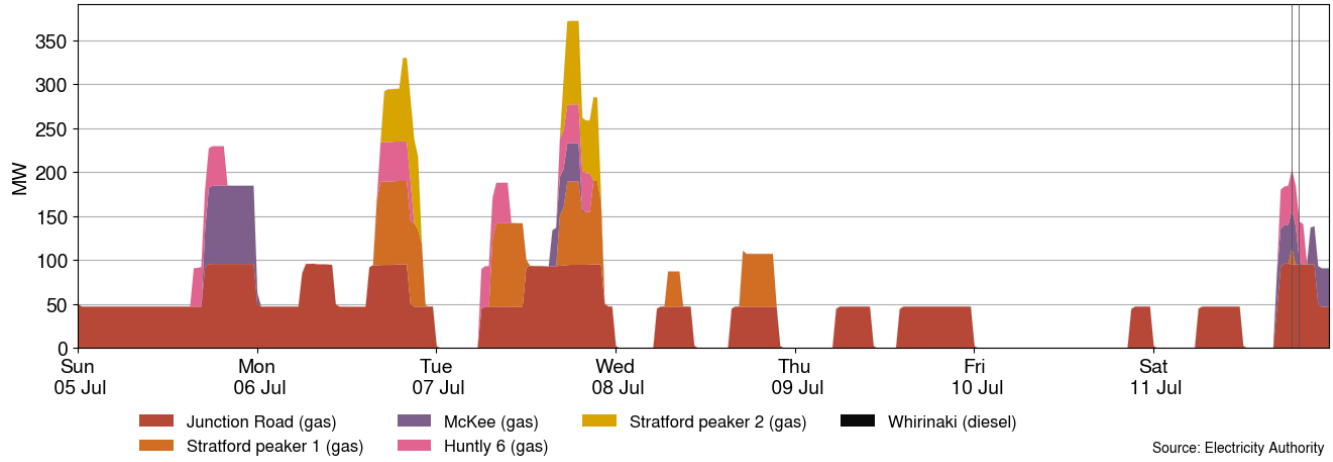

7.15. Figure 15 shows hydro generation between 5-11 July. Hydro generation was mostly above the historic mean throughout the week and exceeded the historic range on Tuesday evening and on Saturday.

Figure 15: Hydro generation, 5-11 July

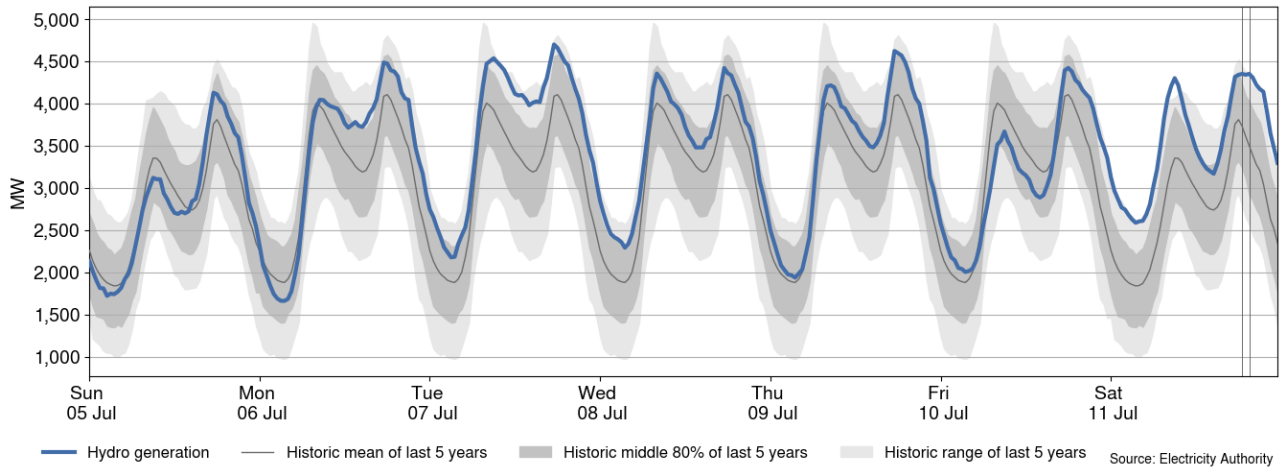

7.16. The highest prices were set by the Stratford Peakers. The most common technology setting prices was hydro, with batteries the second most common. Most marginal prices were between $10-100/MWh.

7.17. Figure 16 shows the distribution of marginal prices this week and what generation technology produced each marginal price. Note there can be multiple marginal plants for each 5-minute period.

7.18. The highest prices were set by the Stratford Peakers. The most common technology setting prices was hydro, with batteries the second most common. Most marginal prices were between $10-100/MWh.

Figure 16: Prices of marginal generation, 5-11 July

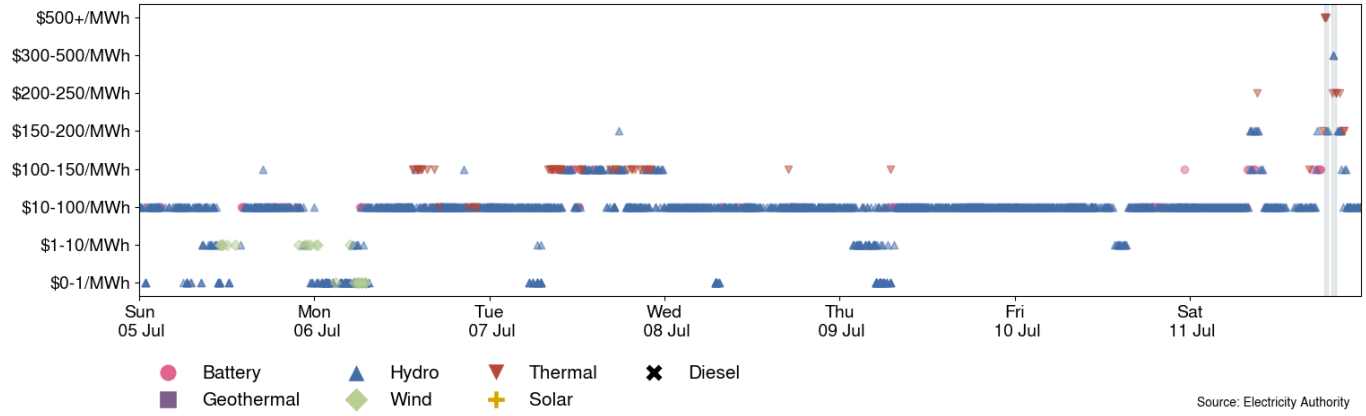

7.19. As a percentage of total generation, between 5-11 July, total weekly hydro generation was 63.6%, geothermal 23.3%, wind 8.3%, thermal 2.9%, co-generation 1.3%, and solar (grid connected) 0.6%, as shown in Figure 17.

Figure 17: Total generation by type as a percentage each week, between 14 June and 11 July

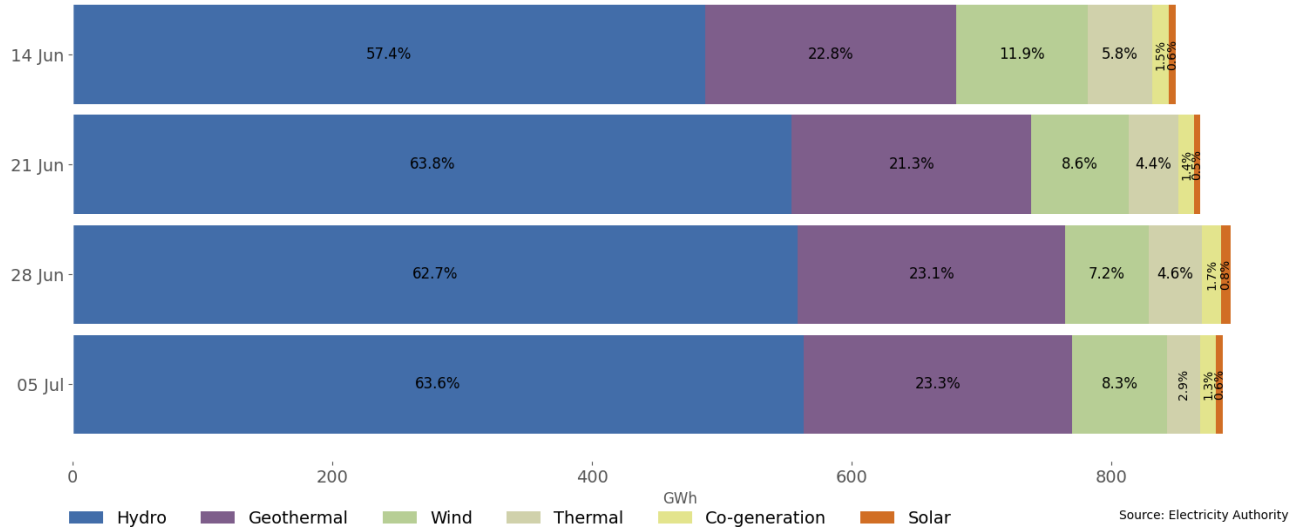

8. Outages

8.1. Figure 18 shows generation capacity on outage. Total capacity on outage between 5-11 July ranged between ~819MW and ~1,686MW. Figure 19 shows the thermal generation capacity outages.

Figure 18: Total MW loss from generation outages, 5-11 July

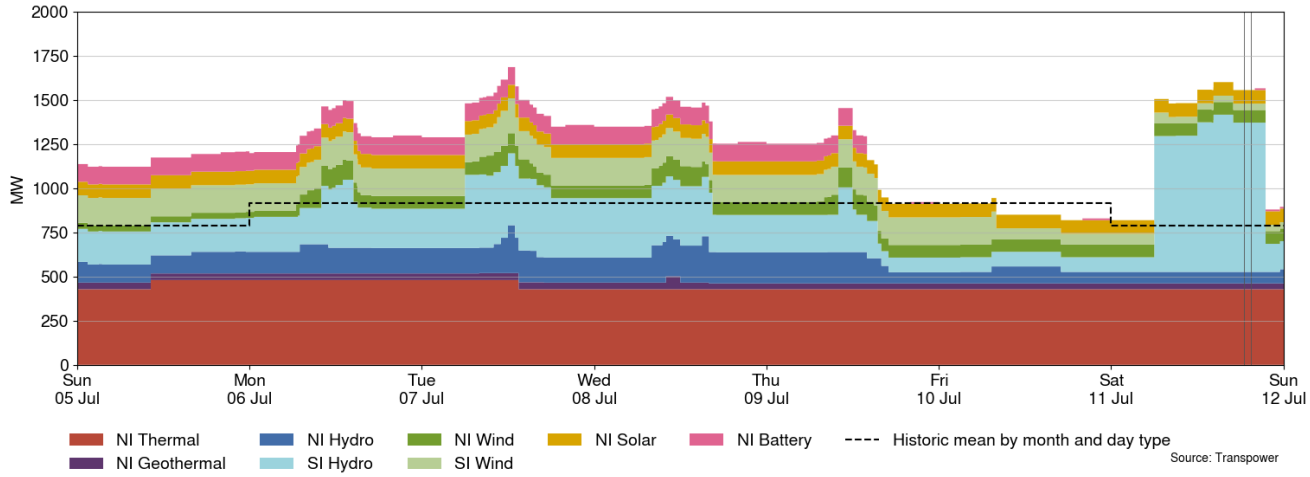

Figure 19: Total MW loss from thermal outages, 5-11 July

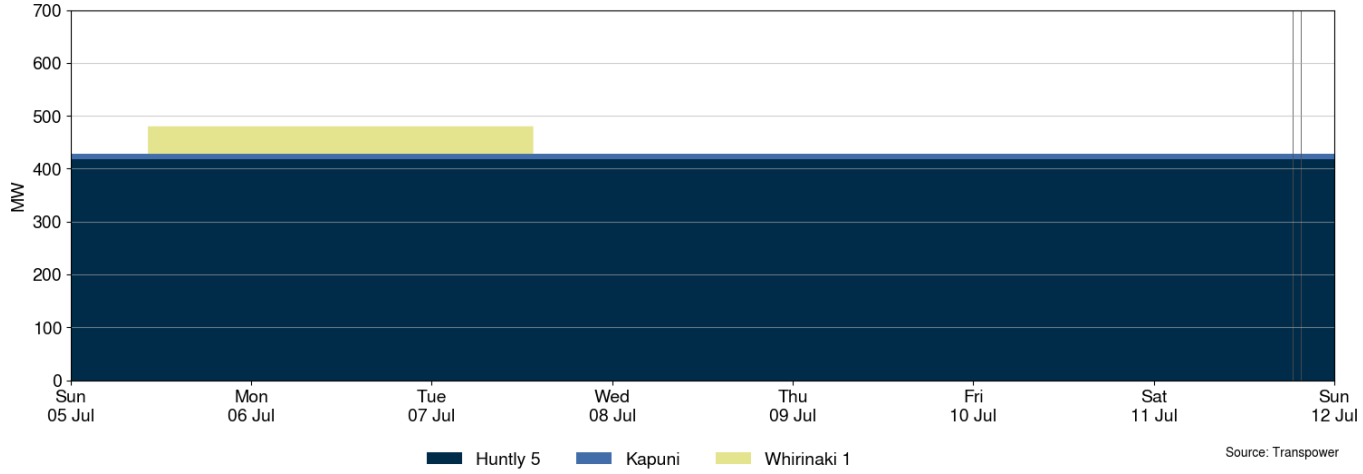

8.2. Notable outages include:

Plant	Partial or Full	End Date
Manapōuri unit 4	Full	8 July 2026
Glenbrook	Full	9 July 2026
Ōhau A, B, & C	Full	11 July 2026
Kaiwaikawe	Full	13 July 2026
Tauhei	Full	18 July 2026
Kaiwera Downs	Full	10 July 2026
Huntly 5	Full	2 August 2026
Roxburgh unit 8	Full	2 September 2026

9. Generation balance residuals

9.1. Figure 20 shows the national generation balance residuals between 5-11 July. A residual is the difference between total energy supply and total energy demand for each trading period. The red dashed line represents the 200MW residual mark which is the threshold at which Transpower issues a customer advice notice (CAN) for a forecast low residual situation. The green dashed line represents the forecast residuals and the blue line represents the real-time dispatch (RTD) residuals.

9.2. The national residual dropped below 500MW on Tuesday and Saturday evenings.

9.3. The lowest national residual of 287MW occurred on Tuesday at 5.30pm. At this time, the North Island residual was 200MW, and the South Island residual was 87MW.

9.4. The national residual also reached 368MW on Saturday at 6.30pm. At this time, the North Island residual was 368MW, and the South Island residual was 0MW.

Figure 20: National generation balance residuals, 5-11 July

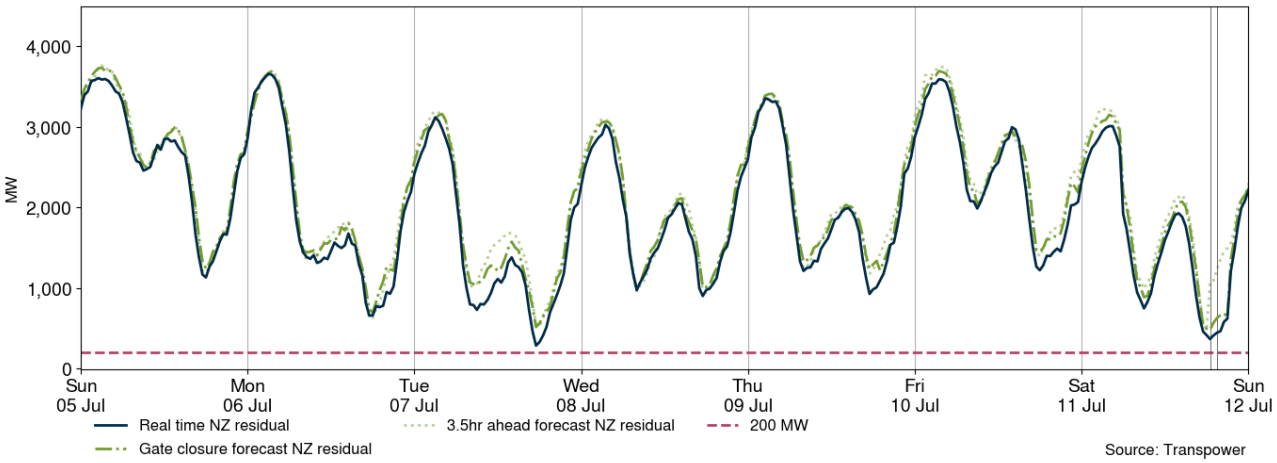

10. Storage/fuel supply

10.1. As of 11 July, national controlled storage was 86% nominally full, and ~130% of the historic average for this time of year.

10.2. Storage at Lake Pūkaki (91% full) remains above its 90th percentile, while storage at Lake Tekapō (76% full) is at its 90th percentile.

10.3. Storage at Lake Te Anau (86% full) and Lake Manapōuri (71% full) remain above their historic means.

10.4. Storage at Lake Taupō (61% full) remains above its historic mean.

10.5. Storage at Lake Hawea (82% full) also remains above its historic mean.

10.6. Figure 21 shows the total controlled national hydro storage as well as the storage of major catchment lakes including their historical mean and 10th to 90th percentiles.

10.7. As of 11 July, national controlled storage was 86% nominally full, and ~130% of the historic average for this time of year.

10.8. Storage at Lake Pūkaki (91% full) remains above its 90th percentile, while storage at Lake Tekapō (76% full) is at its 90th percentile.

10.9. Storage at Lake Te Anau (86% full) and Lake Manapōuri (71% full) remain above their historic means.

10.10. Storage at Lake Taupō (61% full) remains above its historic mean.

10.11. Storage at Lake Hawea (82% full) also remains above its historic mean.

Figure 21: Hydro storage

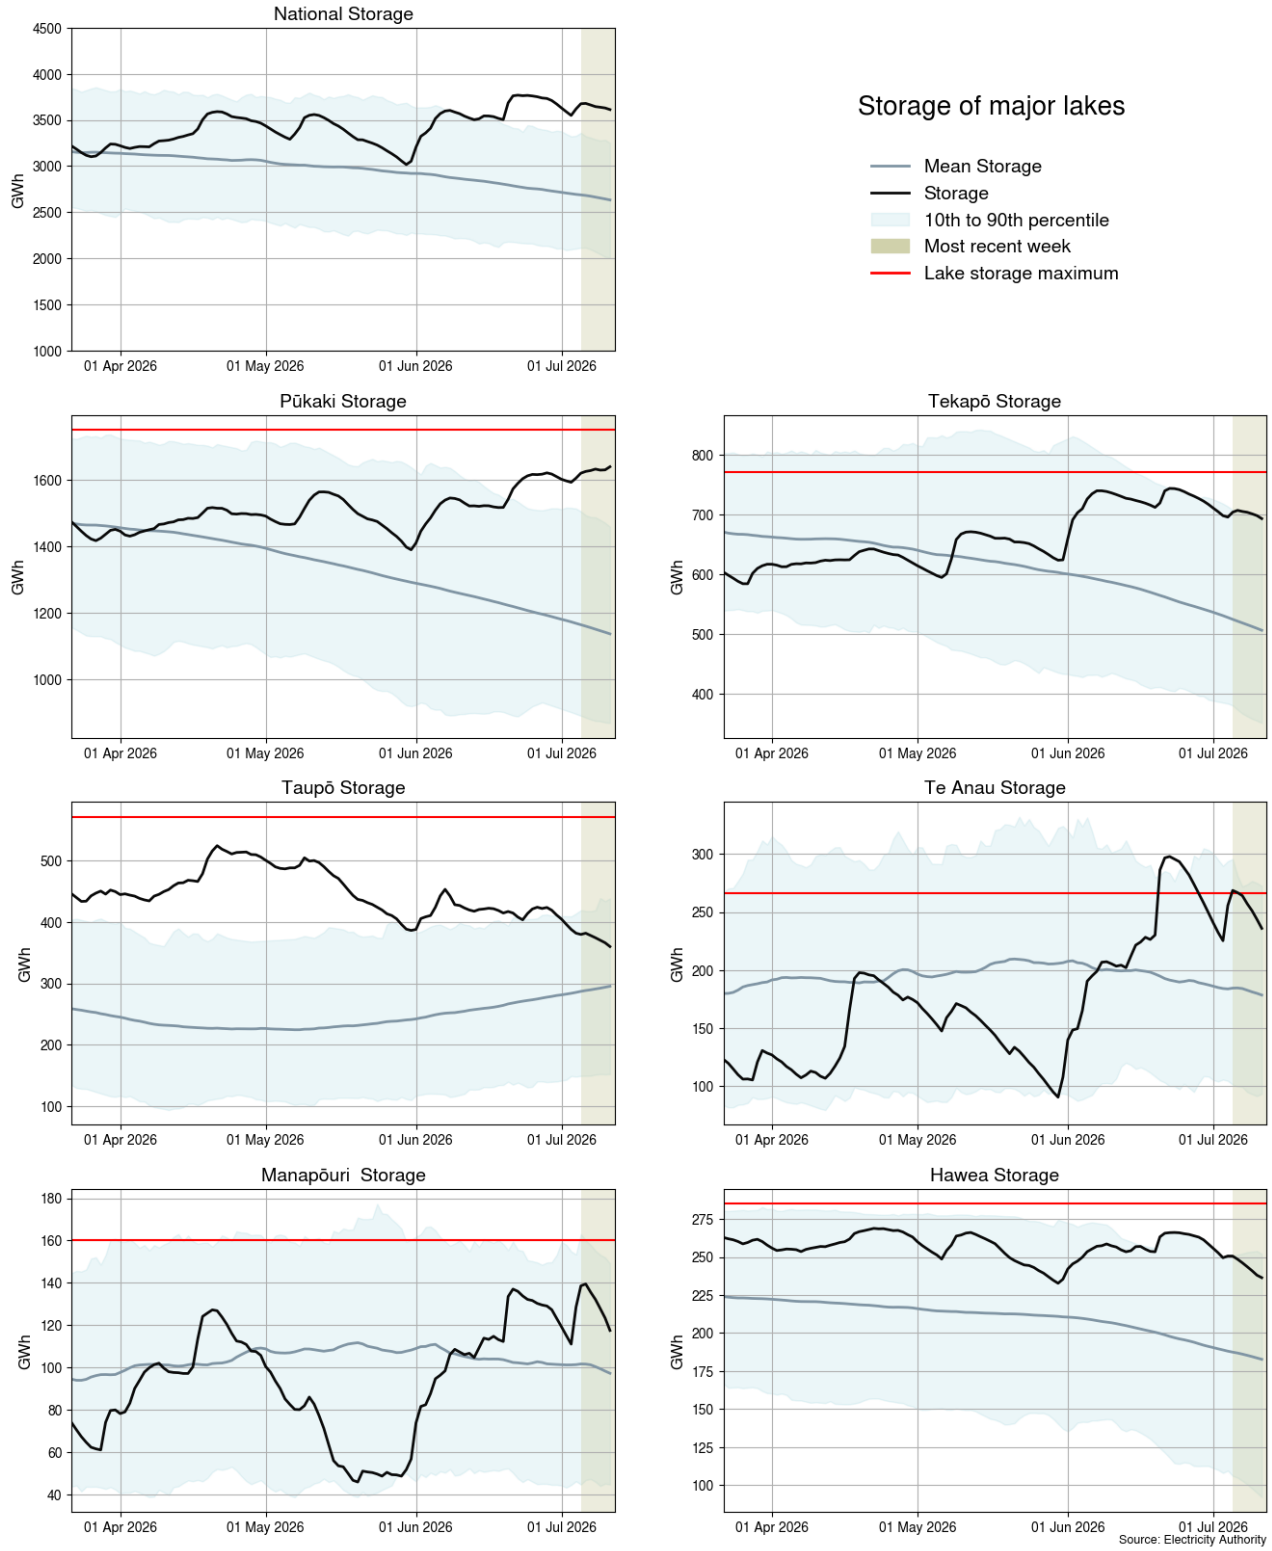

11. Prices versus estimated costs

11.1. In a competitive market, prices should be close to (but not necessarily at) the short-run marginal cost (SRMC) of the marginal generator (where SRMC includes opportunity cost).

11.2. The SRMC (excluding opportunity cost of storage) for thermal fuels is estimated using gas and coal prices, and the average heat rates for each thermal unit. Note that the SRMC calculations include the carbon price, an estimate of operational and maintenance costs, and transport for coal.

11.3. Figure 22 shows an estimate of thermal SRMCs as a monthly average up to 1 July 2026. The SRMCs for gas generation have increased, with SRMCs for coal and diesel fuelled generation remaining steady.

11.4. The latest SRMC of coal-fuelled Rankine generation is ~$238/MWh, while the cost of running the Rankines on gas is ~$181/MWh.

11.5. The SRMC of gas fuelled thermal plants is currently between $122/MWh and $181/MWh.

11.6. The SRMC of Whirinaki is ~$778/MWh.

11.7. Note that coal prices have been rolled forward from May.

11.8. More information on how the SRMC of thermal plants is calculated can be found in Appendix C.

Figure 22: Estimated monthly SRMC for thermal fuels

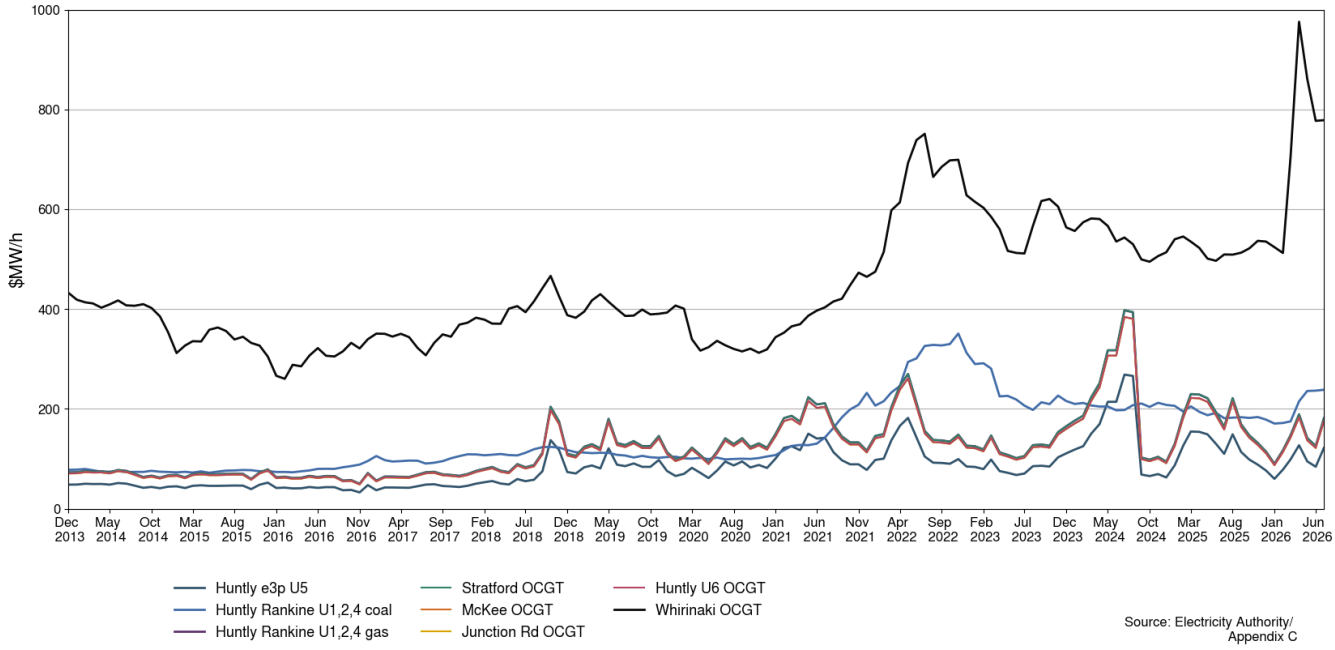

12. Offer behaviour

12.1. Figure 23 shows this week's national daily offer stacks. The black line shows cleared energy, indicating the range of the average final price.

12.2. From Wednesday, Meridian hydro priced down offers from $100-199/MWh to $1-99/MWh.

12.3. Ōhau A, B, & C were on outage from 6.00am to 9.30pm on Saturday.

Figure 23: Daily offer stacks

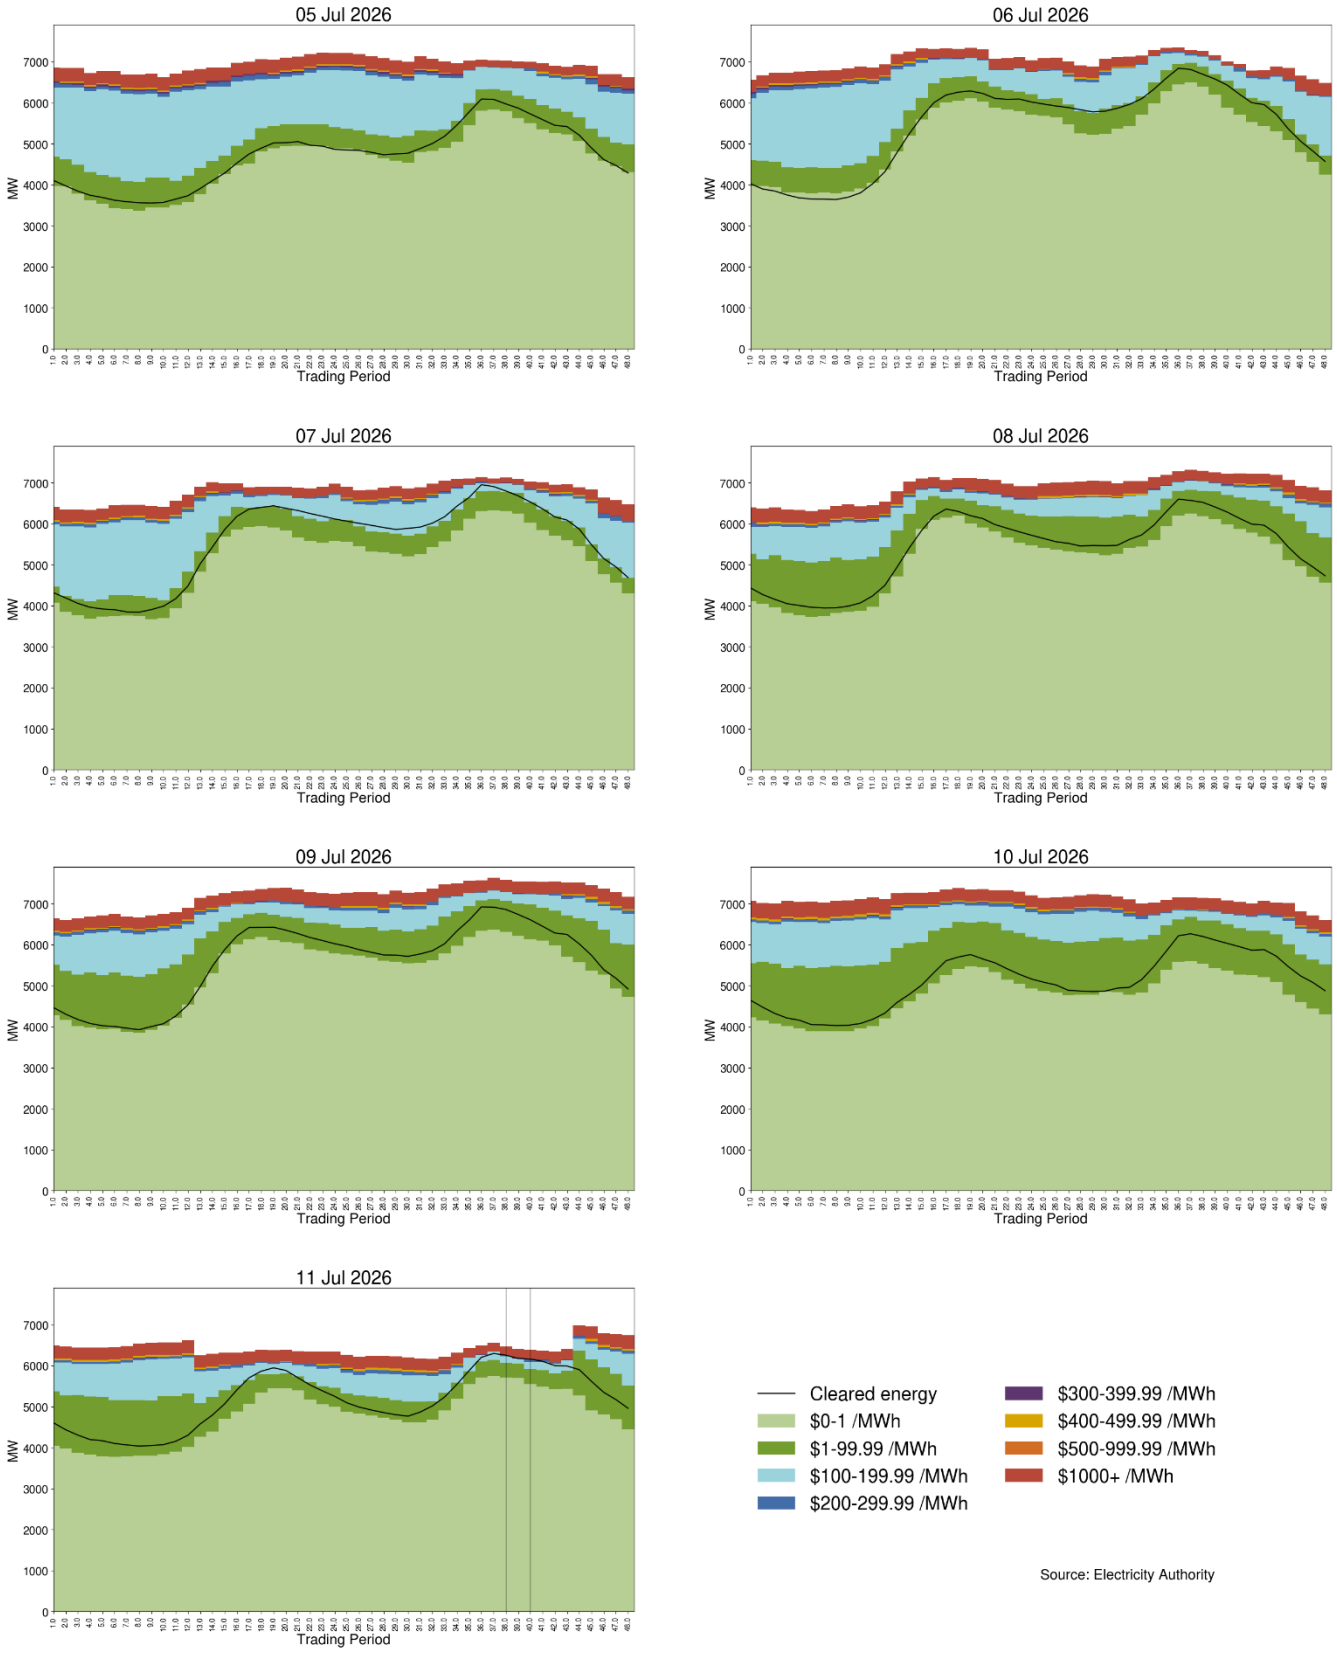

12.4. Figure 24 shows offers above $1,000/MWh in each trading period this week. The largest proportion of these offers are fast start thermal operators.

12.5. If forecast prices are lower than thermal operating costs, this signals some generators may not be needed in that half-hourly trading period. Thermal generators may then price their units high, as they aren't expecting to run. These high prices reflect increased operating costs of running for only a short time. So, if demand is unexpectedly high, intermittent generation dips, or other generation fails, these high-priced thermal generators may get dispatched, sometimes resulting in a high spot price.

12.6. On average 573MW per trading period was priced above $1,000/MWh this week, which is roughly 10% of the total energy available.

Figure 24: High priced offers

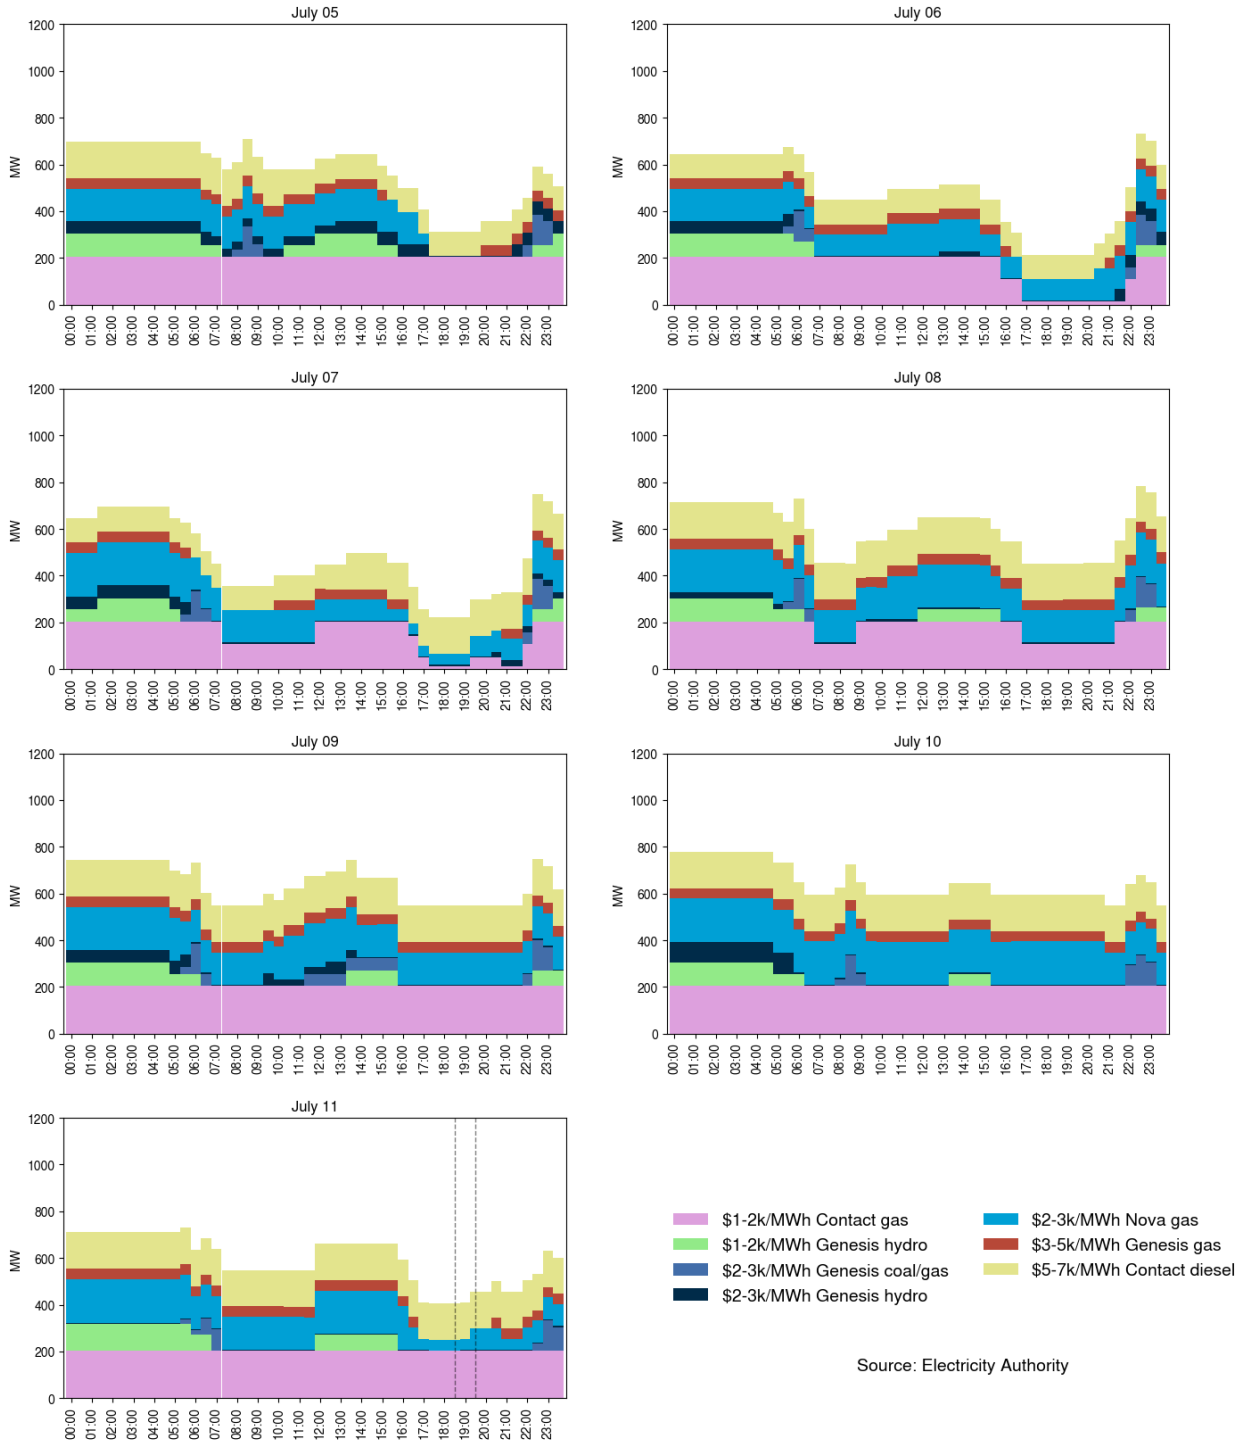

13. Ongoing work in trading conduct

13.1. This week prices generally appeared to be consistent with supply and demand conditions.

13.2. Further analysis is being done on the trading periods in Table 1 as indicated.

Table 1: Trading periods identified for further analysis

Date	Trading period	Status	Participant	Location	Enquiry topic
8/12/2025-11/12/2025	Several	Further analysis	Contact/Manawa	Coleridge, Cobb, and Matahina	Offers
22/04/2026-24/04/2026	Several	Further analysis	Genesis	Tokaanu	Offers
r02/05/2026	Several	Further analysis	Genesis	Tokaanu	Offers
07/05/2026-08/05/2026	Several	Further analysis	Genesis	Tekapō	Offers
27/05/2026	Several	Further analysis	Genesis	Huntly 5	Offers
04/06/2026-05/06/2026	Several	Further analysis	Harbour Infrastructure	Papareireiā solar farm	Reason for no generation
24/06/2026	Several	Further analysis	Contact	Stratford peakers	Offers
3/07/2026	Several	Further analysis	Nova	Junction Road	Offers